
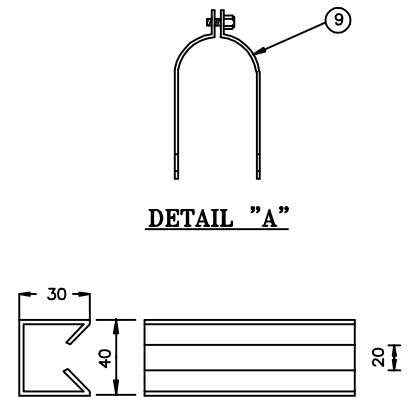
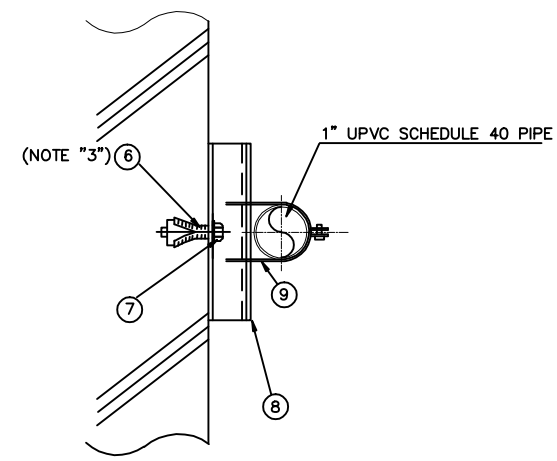
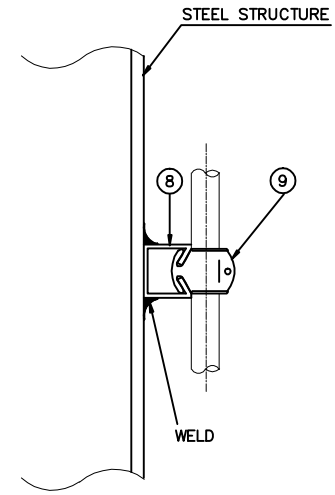


FREE STANDING STUB-UP CONDUIT

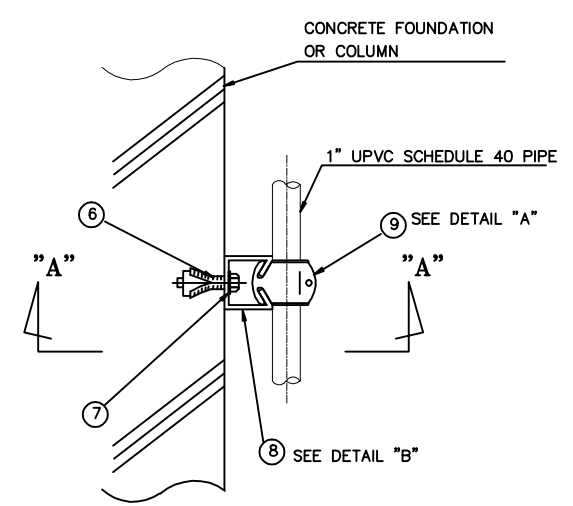

SECTION "A-A"

DETAIL "B"

ITEM NO.	DESCRIPTION
1	1" GALVANISED STEEL CONDUIT
2	NON HARDENING SEALING COMPOUND
3	UNISTRUT CLAMP WITH BOLT/NUT.
4	MASONRY ANCHOR M8
5	BOLT WITH 1-SPRING WASHER AND 1-FLAT FOR MASONRY ANCHOR
6	MASONRY ANCHOR M8
7	BOLT WITH 1-SPRING WASHER AND 1-FLAT FOR MASONRY ANCHOR M8X15L
8	UNISTRUT CHANNEL 40x30x10mm L=120mm; t=4,5mm
9	UNISTRUT CLAMP WITH BOLT/NUT.

- NOTES:-**
- ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
 - END OF RIGID STEEL CONDUIT TO BE REAMED OF ALL BURRS.
 - WHERE REQUIRED, PROTECTION SLEEVE TO BE FORMED ON SITE TO SUIT CONTOUR OF COLUMN, FOOT, PLINTHS ETC. TO AFFORD A NEAT INSTALLATION.
 - ALL STUB-UP CONDUITS SHALL BE SEALED WITH SUITABLE SEALING COMPOUND.

RE-ISSUED FOR TENDER

1	25-02-2022	RE-ISSUED FOR TENDER	MAA	JAB	AIB	PM	MAS
0	07-01-2022	ISSUED FOR TENDER	MAA	JAB	AIB	PM	MAS
A	29-10-2021	ISSUED FOR REVIEW	MAA	JAB	AIB	PM	MAS
REV.	DATE	DESCRIPTION OF REVISION	DRAWN	DESIGN	CHKD.	QC	APPR.
ENAR PETROTECH SERVICES (PRIVATE) LIMITED 7-B, Sector 7-A Korangi Industrial Area, Karachi Pakistan TEL: (9221) 5082791 E-mail: info@enar.com.pk URL: www.enar.com.pk			Job No. 14-0258 Dwg. No. 0258-ELF-6801 Sheet-18				
OIL & GAS DEVELOPMENT COMPANY LTD.			COMPUTER CODE 0258-ELF-6801				
TYPICAL INSTALLATION DETAILS STUB-UP CONDUIT PIPE & SUPPORTS			SHEET SIZE A3				
THIS DOCUMENT IS THE PROPERTY OF ENAR & THE CONTENTS MUST BE TREATED AS CONFIDENTIAL			SCALE 1:1100				